

# Temporary Service Meter Base Installation




Yazoo Valley EPA  
"Strong on Service"

Note:

1. Pole shall be: treated, a minimum length of 15' and a minimum diameter of 5". ( SQUARE POLES ALLOWED).
2. Taller poles may be required for clearance.
3. Do not extend weather head above pole.
4. If using an old pole, the pole must be physically sound.
5. The ground rod shall be a minimum of 8' in length and installed 4" to 6" below ground line. Ground wire shall run continuous from meter base to ground rod.
6. Disconnect shall be fused or breaker type and shall not exceed the amp rating of receptacles and or wiring to receptacles.
7. All electrical equipment attached to pole shall be rain tight and free from physical, structural, or electrical hazards.
8. All holes in meter base and disconnect shall be sealed.
9. The front cover shall be in place on the disconnect.
10. Pole must pass YVEPA inspection before meter is set. Reinspection fees may be required.
11. For overhead footage requirements use YVEPA policy guidelines.
12. 30" Max. separation between conduit straps.
13. Min. service entrance wire size is #4 copper.
14. 30" Max. separation between conduit straps.

Bracing Or Guying  
May Be Required  
For Extra Support.

**\$75.00  
REINSPECTION  
FEE IF METER  
BASE IS NOT  
INSTALLED  
AS SHOWN**

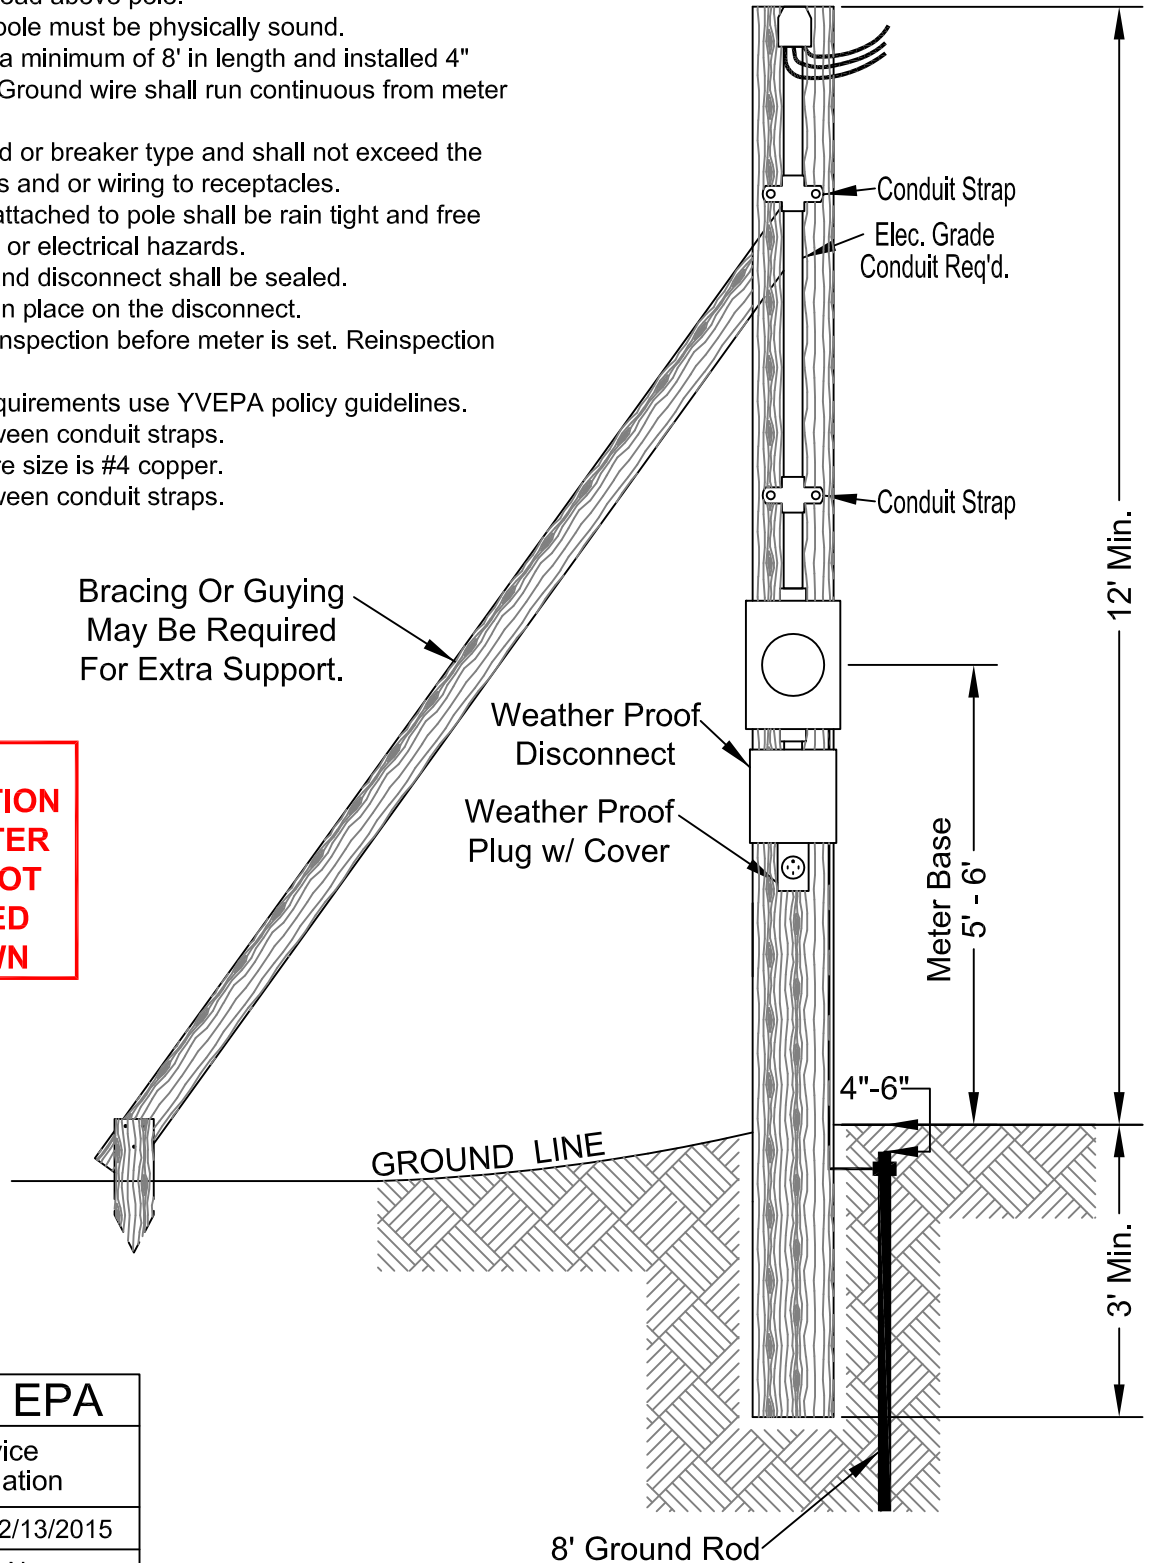

<b>Yazoo Valley EPA</b>	
Temporary Service Meter Base Installation	
Approved by: MN	Date: 2/13/2015
Checked by: MN	Scale: None
Drawn by: MN	